


EXISTING ELEVATION

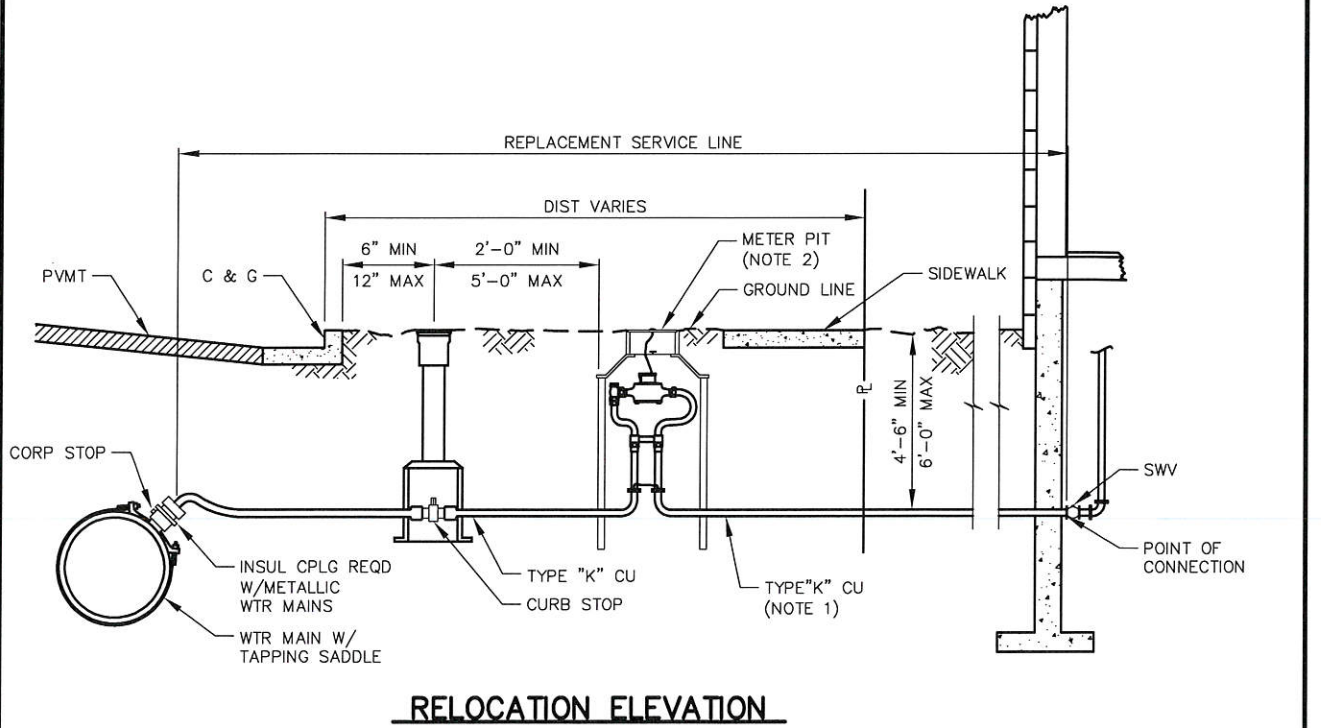

RELOCATION ELEVATION

NOTES:

1. LIMITS OF REPLACEMENT OF NON-COPPER SERVICE LINE BY DENVER WATER EXTENDS FROM THE TAP TO THE FIRST BRASS FITTING INSIDE THE STRUCTURE.
2. WATER METER SHALL BE RELOCATED FROM AN INSIDE SETTING TO AN OUTSIDE SETTING IN ACCORDANCE WITH SHEET 55.

ERRATA 7

D DENVER WATER	
2" & SMALLER NON-COPPER SERVICE LINE REPLACEMENT & INSIDE METER RELOCATION	
Scale: <u> NONE </u>	Date: <u> November 2016 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: <u> Stephen C. Ross </u>	Dr. <u> 127 </u> No. <u> 35 </u>