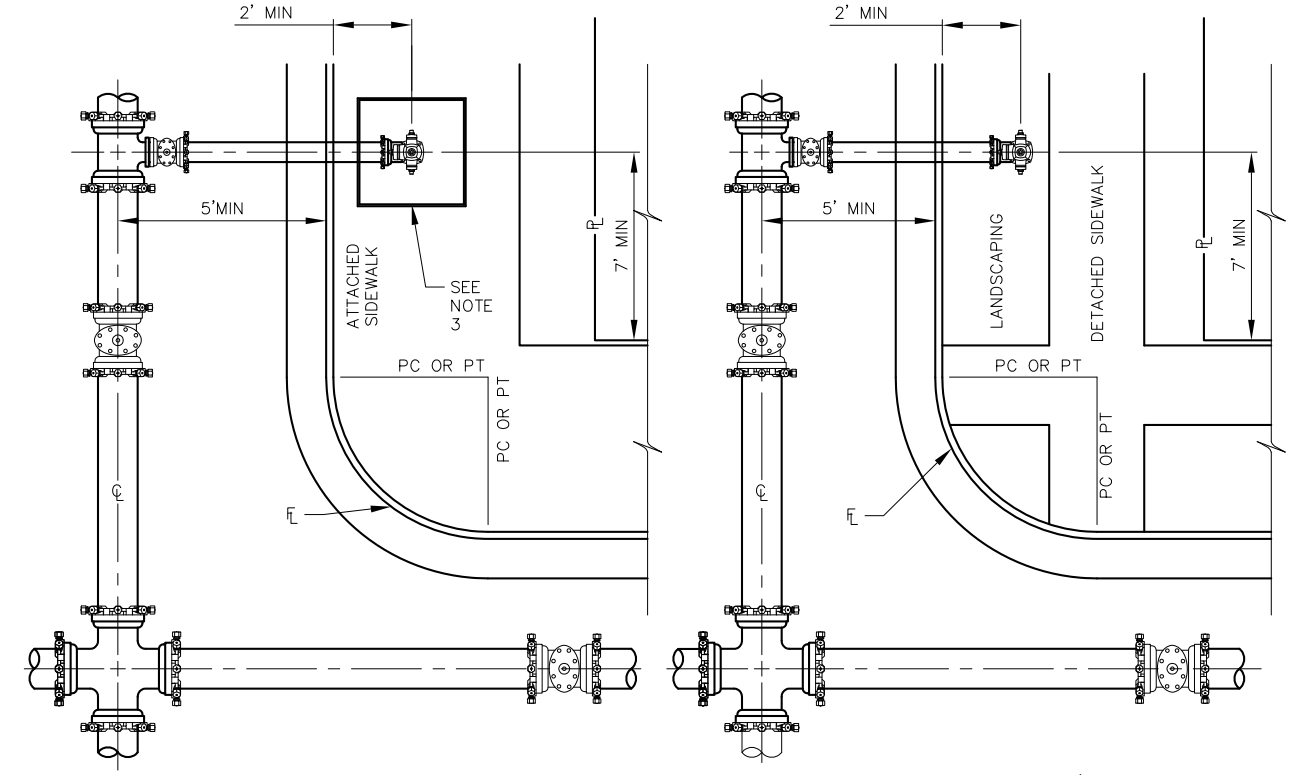

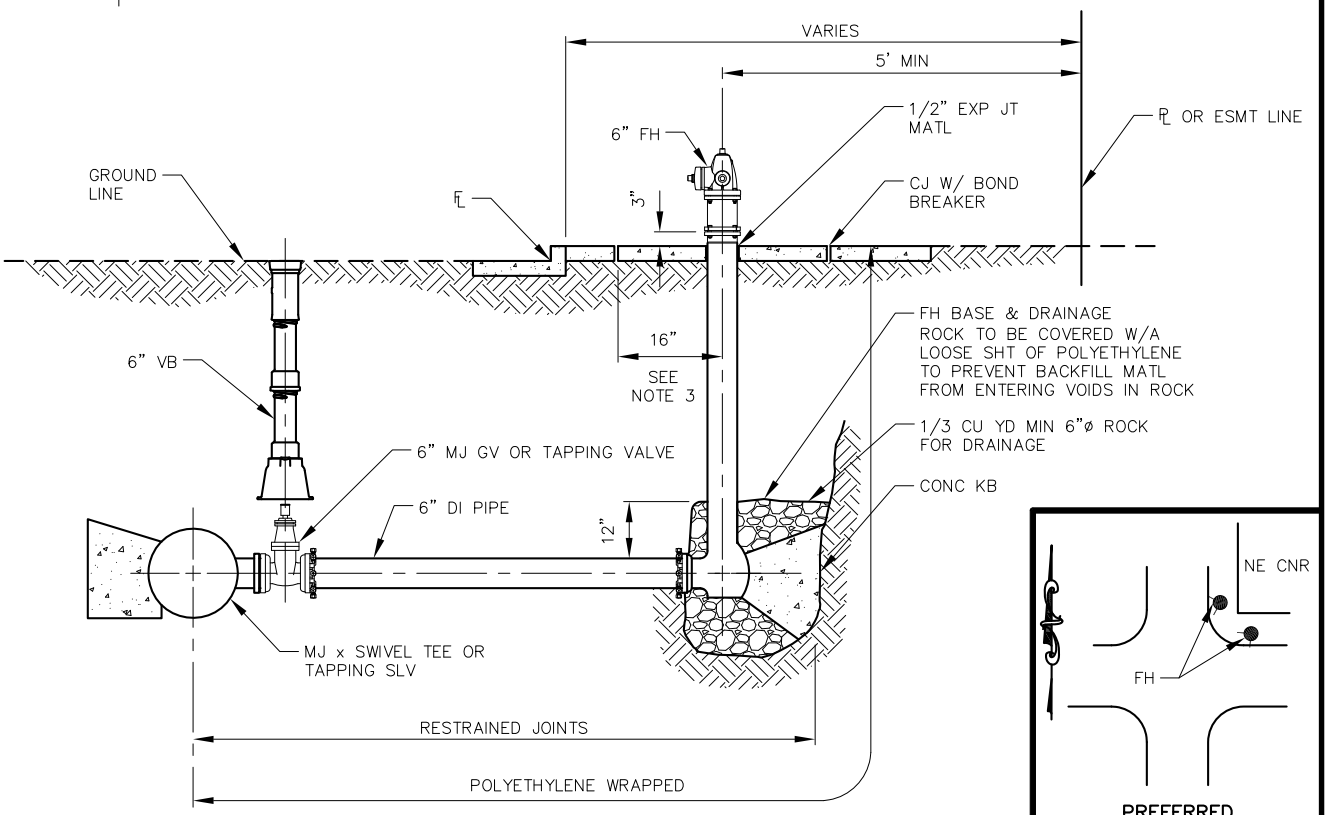

PREFERRED FIRE HYDRANT LOCATION

NOTES:

1. NO HORIZONTAL OR VERTICAL BENDS ARE ALLOWED IN FIRE HYDRANT BRANCH. FOR EXCEPTIONS SEE CHAPTER 5.
2. DO NOT COVER OR PLUG DRAIN HOLES WITH CONCRETE.
3. PROVIDE A 32"x 32" CONCRETE PAD WITH CONSTRUCTION JOINT BOND BREAKERS WHEN FIRE HYDRANT IS INSTALLED IN SIDEWALK OR SIMILAR PAVED AREA.

DENVER WATER
1600 West 12th Avenue • Denver, Colorado 80204
Phone(303)628-6000 • Telecopier No.(303)628-6851

PLAN, PROFILE, & LOCATION FOR FIRE HYDRANTS, MAINS, & VALVES

Scale: NONE	Date: June 2014
Drawn: C.A.M.	Ck: K ROSS
Approved: Steph C. Ramm	Dr. 127 No. 35