


2" & SMALLER DOMESTIC

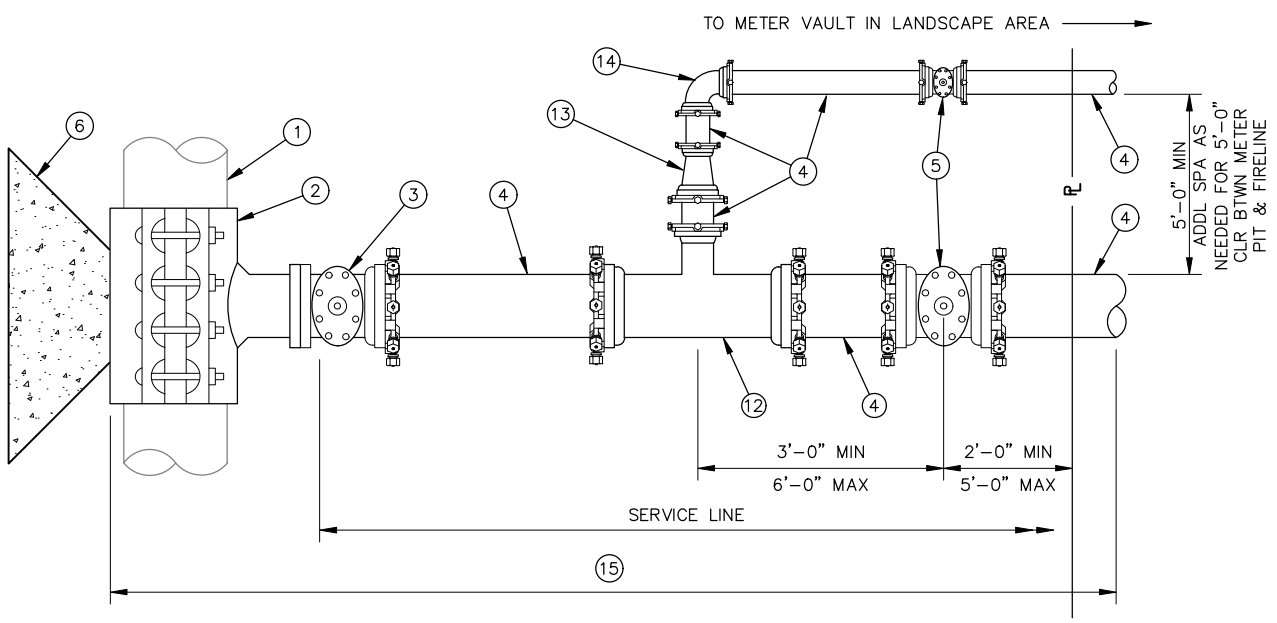

3" DOMESTIC

KEYED NOTES:

- ① EXIST WTR MAIN
- ② TAPPING SLV OR ANCHORING TEE
- ③ TAPPING VLV OR MJ GV
- ④ DIP FULLY RESTRAINED
- ⑤ MJ GV
- ⑥ CONC KB
- ⑦ TAPPING SADDLE
- ⑧ CORP STOP
- ⑨ SERVICE INSULATOR
- ⑩ TYPE "K" Cu PIPE
- ⑪ CURB STOP
- ⑫ MJ TEE
- ⑬ 4"x 3" MJ RDCR
- ⑭ 90° MJ ELB
- ⑮ PE WRAPPED

NOTE:

THE MINIMUM LINE SIZE RATIO FOR FIRE SERVICE LINE TO DOMESTIC SERVICE LINE IS 4:1, RESPECTIVELY.

DRAWN BY: <i>BAIRES</i>
CHKD BY: <i>K ROSS/</i>
APPD BY:
ORIGINATION DATE: <i>JANUARY 2021</i>
REVISION DATE:

33262
FIRELINE CONNECTION
WITH DOMESTIC SERVICE TAP

DENVER WATER
 1600 West 12th Ave
 Denver, Colorado 80204-3412
 T: 303.628.6000
 F: 303.628.6851
 denverwater.org