


OPTIONAL RESTRAINED
DISMANTLING JOINT

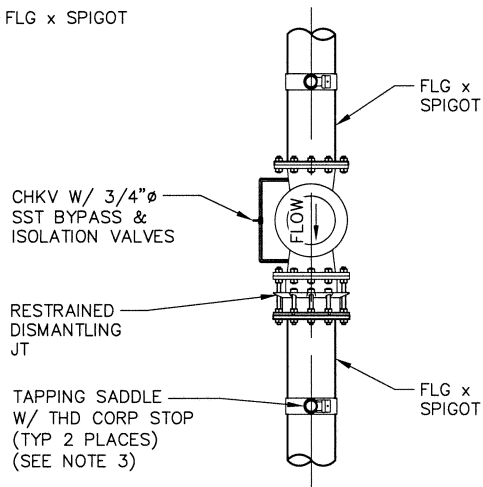

NOTES:

1. SEE SHEET 35 FOR TYPICAL SECTION.
2. DO NOT PLACE SUMP DIRECTLY UNDER A MANHOLE ACCESS OPENING.
3. FOR PIPE SIZES LESS THAN 12-INCHES, CORP STOPS SHALL BE 1-INCH, FOR PIPE SIZES 16 & 20-INCH, CORP STOPS SHALL BE 2-INCH

D DENVER WATER	
CHECK VALVE MANHOLE INSTALLATION TYPICAL PLAN	
Scale: <u> NONE </u>	Date: <u> May 2018 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: <u> Steph C. Rem </u>	Dr. <u> 127 </u> No. <u> 35 </u>