


**2" & SMALLER DOMESTIC**

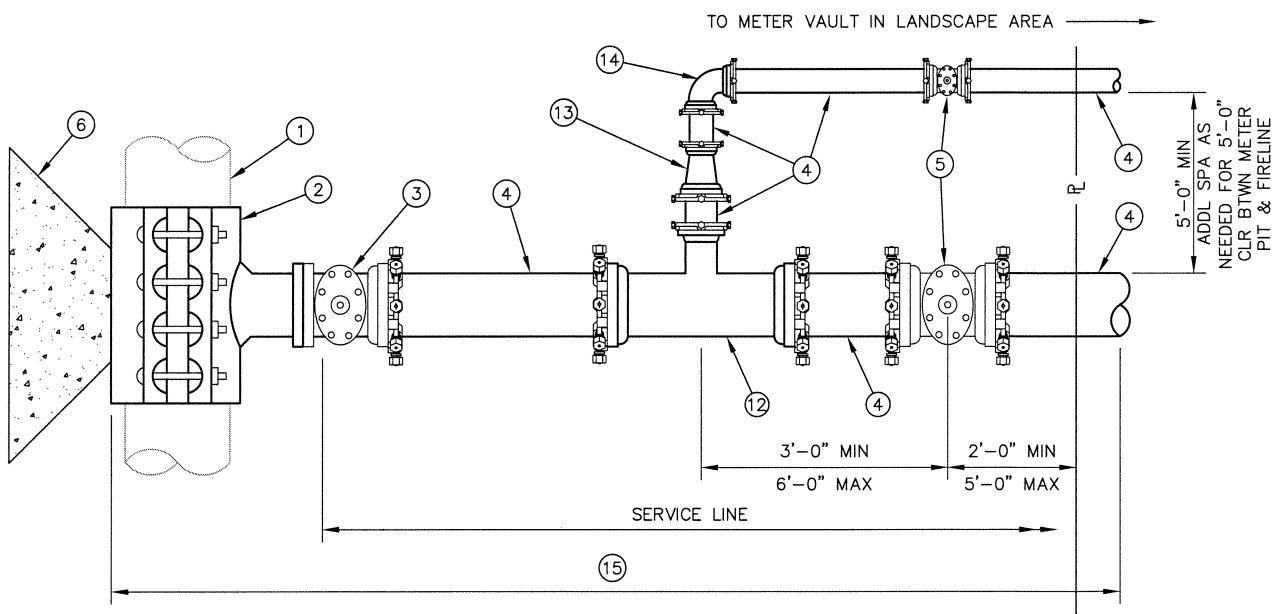

**3" DOMESTIC**

**KEY NOTES:**

- ① EXIST WTR MAIN
- ② TAPPING SLV OR ANCHORING TEE
- ③ TAPPING VALVE OR MJ GV
- ④ DI PIPE FULLY RESTRAINED
- ⑤ MJ GV
- ⑥ CONC KB
- ⑦ TAPPING SADDLE
- ⑧ CORP STOP
- ⑨ SERVICE INSULATOR
- ⑩ TYPE "K" CU PIPE
- ⑪ CURB STOP
- ⑫ MJ TEE
- ⑬ 4"x 3" MJ RDCR
- ⑭ 90° MJ ELB
- ⑮ POLYETHYLENE WRAPPED

**NOTE:**

THE MINIMUM LINE SIZE RATIO FOR FIRE SERVICE LINE TO DOMESTIC SERVICE LINE IS 4:1, RESPECTIVELY.

<b>D DENVER WATER</b>	
<b>FIRELINE CONNECTION WITH DOMESTIC SERVICE TAP</b>	
Scale: <u>  NONE  </u>	Date: <u>  May 2018  </u>
Drawn: <u>  RLB  </u>	Ck: <u>  K ROSS  </u>
Approved: <u>  Stephen C. Pen  </u>	Dr. <u>  127  </u> No. <u>  35  </u>