




OPTION 1
MULTI-PURPOSE PIPING SYSTEM
(PREFERRED)

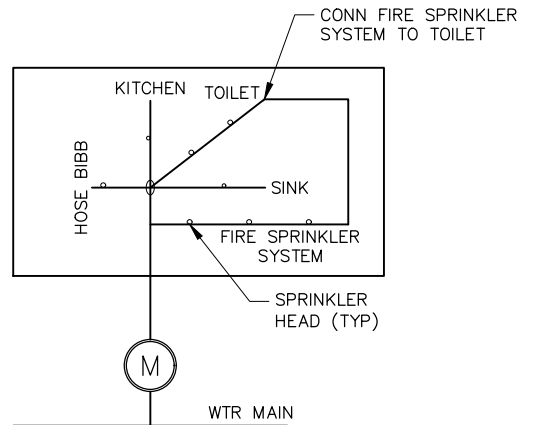

OPTION 2
MULTI-PURPOSE PIPING SYSTEM
(PASSIVE PURGE)

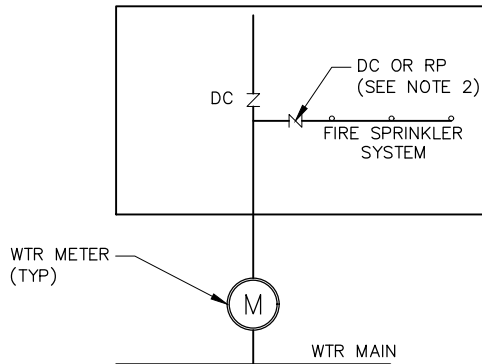

OPTION 3
BRANCHED

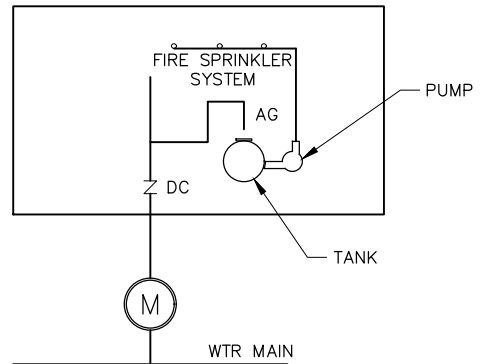

OPTION 4
TANK

NOTES:

1. MULTI-PURPOSE PIPING SYSTEM SHALL MEET NATIONAL FIRE PROTECTION ASSOCIATION 13D REQUIREMENTS; BACKFLOW PREVENTION ASSEMBLY IS NOT REQUIRED.
2. CHEMICAL ADDITIVES REQUIRE INSTALLATION OF A DOUBLE CHECK VALVE OR REDUCED PRESSURE PRINCIPAL BACKFLOW PREVENTER ON SPRINKLER SYSTEM BRANCH LINE. DC OR RP SHALL BE APPROVED BY DENVER WATER PRIOR TO INSTALLATION.
3. OPTIONS 3 AND 4 SHALL BE APPROVED BY DISTRIBUTOR AND LOCAL FIRE DEPARTMENT PRIOR TO APPLICATION FOR WATER SUPPLY LICENSE.
4. OPTION 4 IS NOT APPROVED FOR USE WITHIN DENVER, TOTAL SERVICE, AND READ & BILL CONTRACT AREAS.
5. AIR-GAP SIZING AND ASSOCIATED TANK DETAILS MAY BE REQUIRED BY DENVER WATER PRIOR TO APPROVAL AND INSTALLATION.
6. NFPA 13D SYSTEM REQUIREMENTS FOR INDIVIDUAL UNITS WITHIN A MULTI-FAMILY BUILDING SHALL BE IN ACCORDANCE WITH OPTIONS 1 OR 2 AND APPROVED IN WRITING BY THE LOCAL FIRE DEPARTMENT.

ERRATA 2



**NATIONAL FIRE PROTECTION ASSOCIATION 13D
RESIDENTIAL SPRINKLER SERVICES**

Scale: <u> NONE </u>	Date: <u> January 2020 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: <u> <i>[Signature]</i> </u>	Dr. <u> 127 </u> No. <u> 35 </u>