


# ALLEY

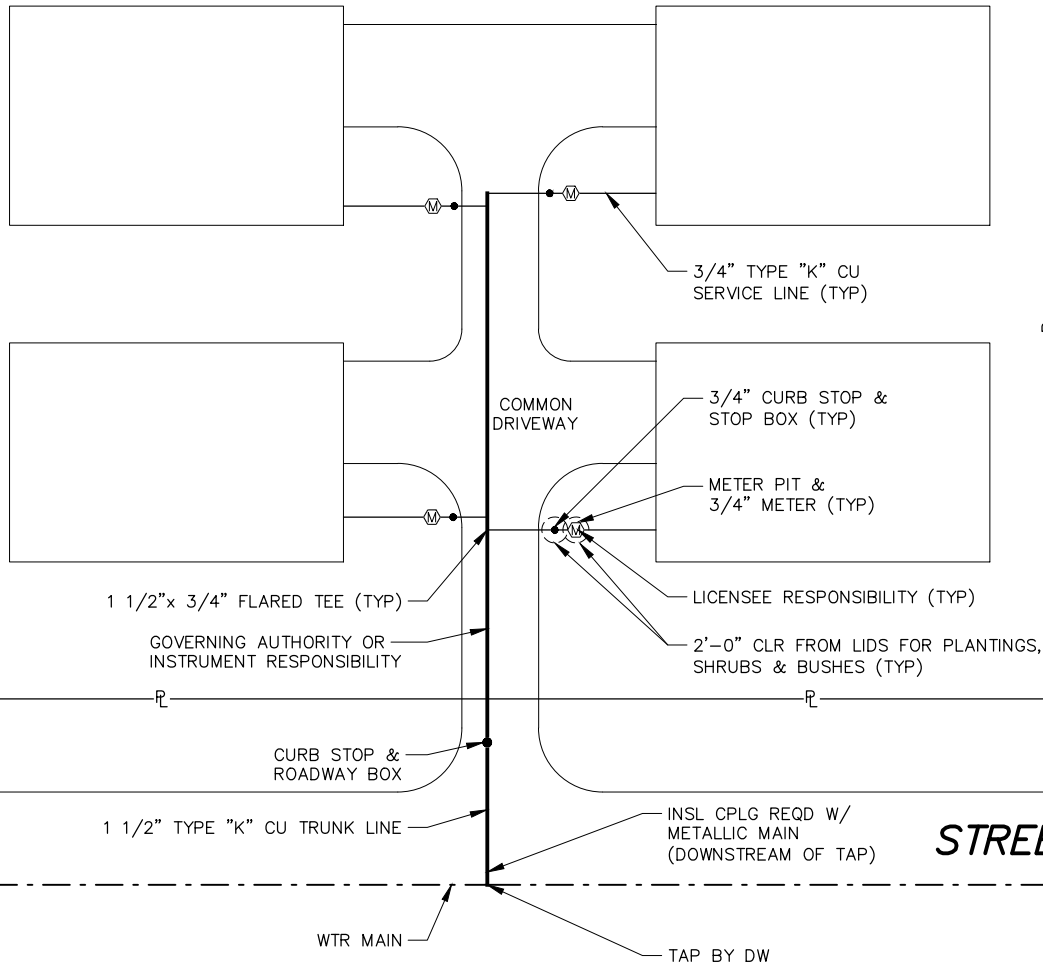

**NOTES:**

1. THIS STANDARD DRAWING APPLIES TO DEVELOPMENTS WITH 3 TO 6 UNITS PLUS A COMMON PROPERTY.
2. METER PITS SHALL BE IN ACCORDANCE WITH SHEET 55.
3. IRRIGATION USE SHALL HAVE A DEDICATED IRRIGATION SERVICE LINE. IRRIGATION SERVICE IS NOT ALLOWED ON A MANIFOLD
4. NFPA 13D DEMAND SHALL HAVE A DEDICATED SERVICE LINE. FIRE SERVICE IS NOT ALLOWED ON A MANIFOLD.
5. MANIFOLD SHALL BE INSPECTED BY DENVER WATER PRIOR TO BACKFILL.
6. IDENTIFICATION TAGS SHALL BE ATTACHED IN ACCORDANCE WITH SPECIFICATION SECTION 3.02-G.
7. RESIDENTIAL FIXTURE UNITS THAT DEMAND A 1-INCH SERVICE LINE SHALL HAVE A 2-INCH MANIFOLD TRUNK LINE AND A 1-INCH SERVICE LINE.
8. INSTALL METER PIT IN ACCORDANCE WITH SPECIFICATION SECTION 3.02.

ERRATA 2



## MANIFOLD SERVICE LINE WITH SHARED ACCESS

Scale: <u>  NONE  </u>	Date: <u>  January 2020  </u>
Drawn: <u>  RLB  </u>	Ck: <u>  K ROSS  </u>
Approved: <u>  <i>[Signature]</i>  </u>	Dr. <u>  327  </u> No. <u>  35  </u>