


PLAN

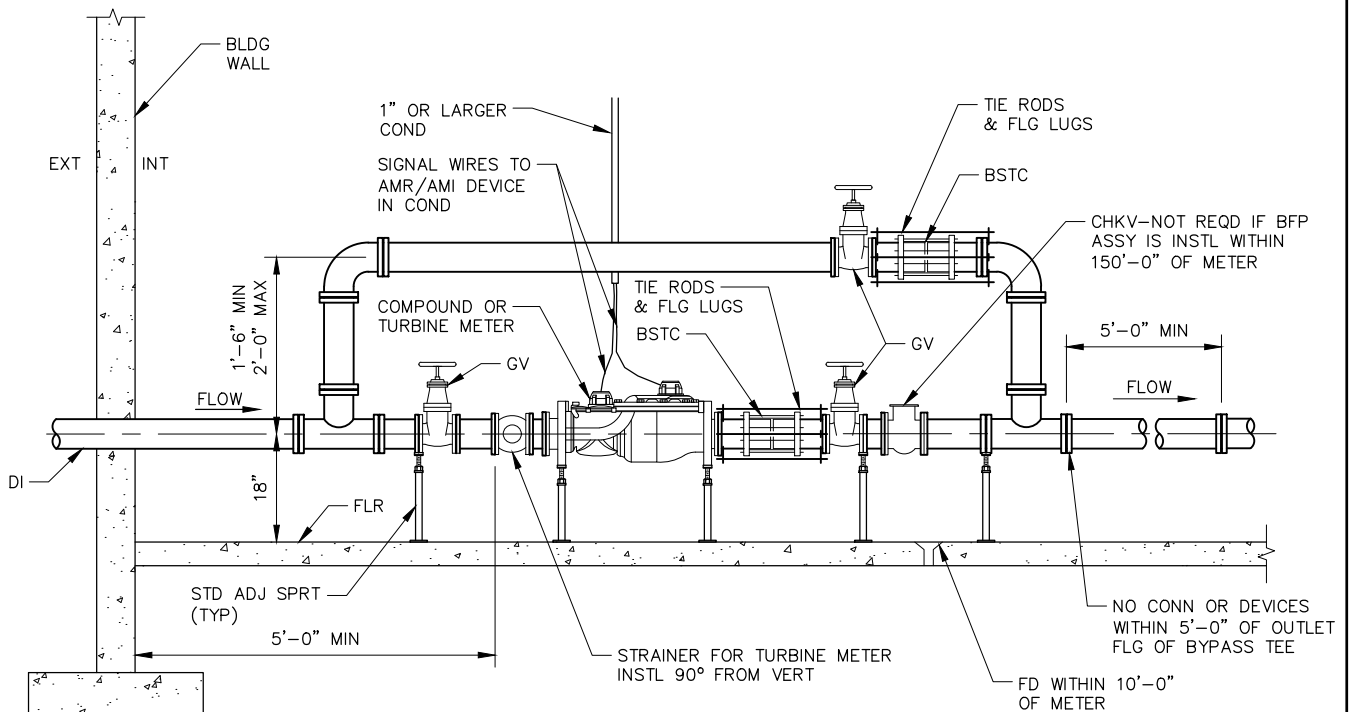

ELEVATION

NOTES:

1. NEW INSIDE METER INSTALLATIONS ARE PERMITTED ONLY BY WRITTEN APPROVAL. EXISTING INSIDE METER INSTALLATIONS MUST COMPLY WITH THIS DRAWING.
2. PIPING FOR 3-INCH AND LARGER METERS SHALL BE FLANGED DUCTILE IRON FROM THE METER THROUGH THE BFP.
3. INSTALLATION SHALL ALLOW FOR FULL ACCESS TO THE METER AND VALVES AND PROVIDE PROTECTION FROM FREEZING WITH A MINIMUM 2- FEET CLEARANCE TO WALL.
4. GATE VALVES SHALL BE NON-RISING STEM, RIGHT HAND OPEN, WITH HAND WHEEL OPERATORS.
5. FOR INSIDE SETTINGS, THE PROPERTY OWNER SHALL PROVIDE A DETAILED DRAWING SHOWING DIMENSIONS OF THE METER ROOM INCLUDING PIPING AND EQUIPMENT WITH APPROPRIATE DIMENSIONS FOR DENVER WATER APPROVAL PRIOR TO CONSTRUCTION.
6. THE TURBINE METER REQUIRES A STRAINER BEFORE THE METER.
7. WALL PENETRATIONS SHALL BE GROUTED WITH CONCRETE.

ERRATA 3

D DENVER WATER	
INSIDE SETTING FOR 3" & LARGER METER	
Scale: <u> NONE </u>	Date: <u> May </u> <u> 2020 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved:	Dr. <u> 127 </u> No. <u> 35 </u>