


PLAN

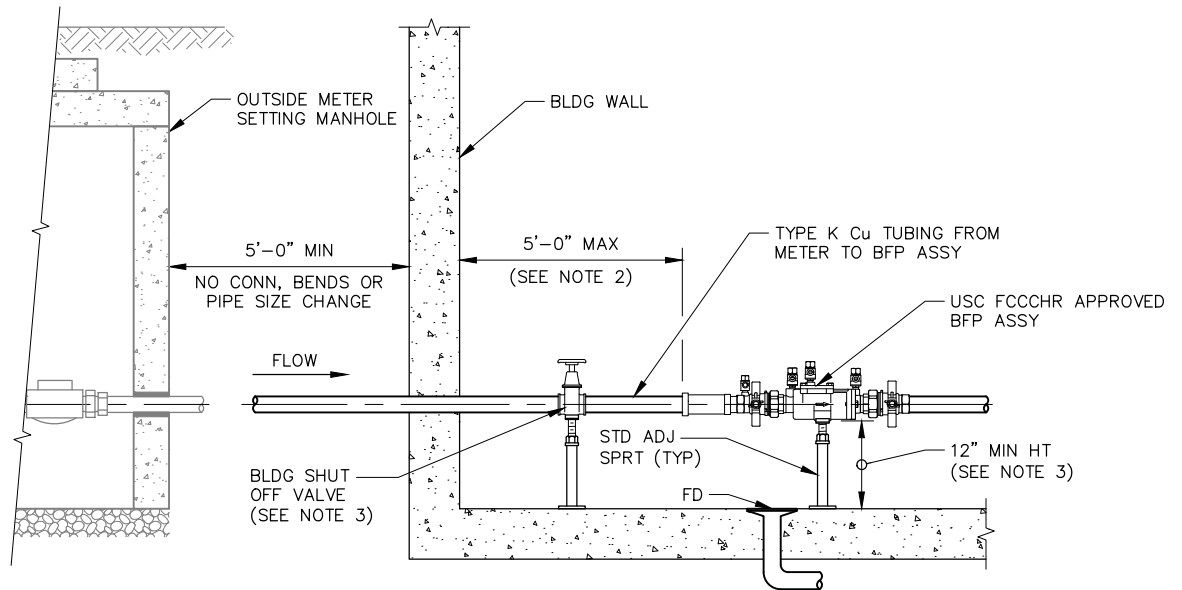

ELEVATION


ERRATA 3

NOTES:

1. USC FCCCHR APPROVED DOUBLE CHECK VALVE OR REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY SHALL BE OR IS DETERMINED BY THE DEGREE OF HAZARD POSED BY INTERNAL PLUMBING USE.
2. PLACEMENT OF BACKFLOW PREVENTION ASSEMBLY SHALL BE A MAXIMUM OF 5- FEET FROM THE INSIDE WALL OF BUILDING.
3. REFER TO LOCAL CODES AND MANUFACTURER REQUIREMENTS FOR INSTALLATION INSTRUCTIONS.
4. INSTALL STANDARD ADJUSTABLE SUPPORTS WITHIN 12-INCHES OF INLET AND OUTLET ISOLATION VALVES.



**INSIDE BACKFLOW PREVENTION ASSEMBLY FOR
OUTSIDE SETTING OF 1 1/2" & 2" METER &
BYPASS IN MANHOLE**

Scale: <u> NONE </u>	Date: <u> May </u> <u> 2020 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: 	Dr. <u> 127 </u> No. <u> 35 </u>