


PLAN

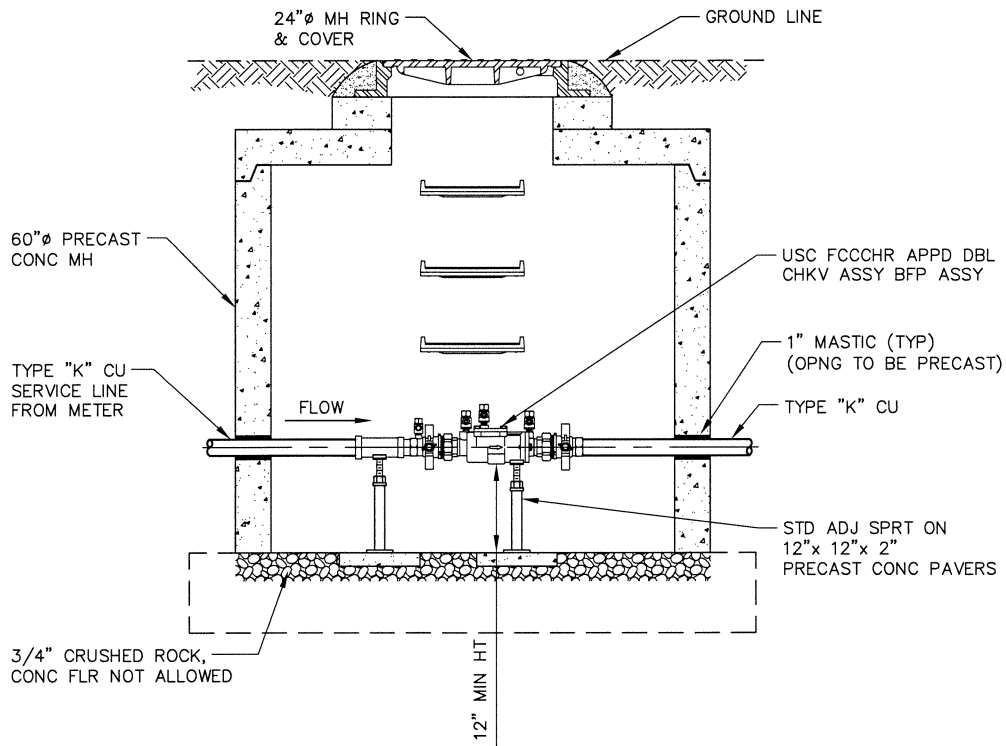

ELEVATION

NOTES:

1. DIAMETER OF FITTINGS, NIPPLE, AND TUBING SHALL BE EQUAL IN DIAMETER TO THE BACKFLOW PREVENTER.
2. REFER TO LOCAL CODES AND MANUFACTURER REQUIREMENTS FOR INSTALLATION INSTRUCTIONS.



OUTSIDE SETTING FOR 2" & SMALLER DOUBLE CHECK VALVE ASSEMBLY IN MANHOLE

Scale: <u> NONE </u>	Date: <u> May 2018 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: <u> [Signature] </u>	Dr. <u> 127 </u> No. <u> 35 </u>