


**ELEVATION**

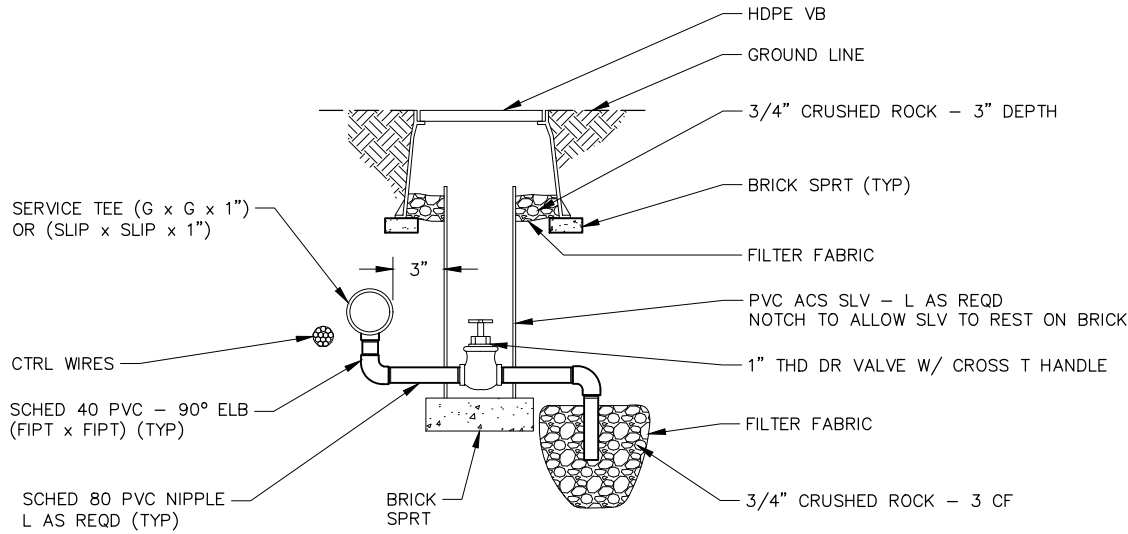

**MANUAL DRAIN VALVE**

**ERRATA 3**

**NOTES:**

1. CONCRETE PAD PENETRATIONS SHALL BE 1-INCH LARGER THAN PIPE DIAMETER.
2. DIAMETER OF FITTINGS, NIPPLE, AND TUBING SHALL BE EQUAL IN DIAMETER TO THE BACKFLOW PREVENTER.
3. REFER TO LOCAL CODES AND MANUFACTURER REQUIREMENTS FOR SPECIFIC INSTALLATION INSTRUCTIONS.

<b>D DENVER WATER</b>	
<b>IRRIGATION OUTSIDE SETTING FOR 2" &amp; SMALLER REDUCED PRESSURE PRINCIPLE ASSEMBLY IN ENCLOSURE</b>	
Scale: <u>  NONE  </u>	Date: <u>  May  </u> <u>  2020  </u>
Drawn: <u>  RLB  </u>	Ck: <u>  K ROSS  </u>
Approved:	Dr. <u>  127  </u> No. <u>  35  </u>