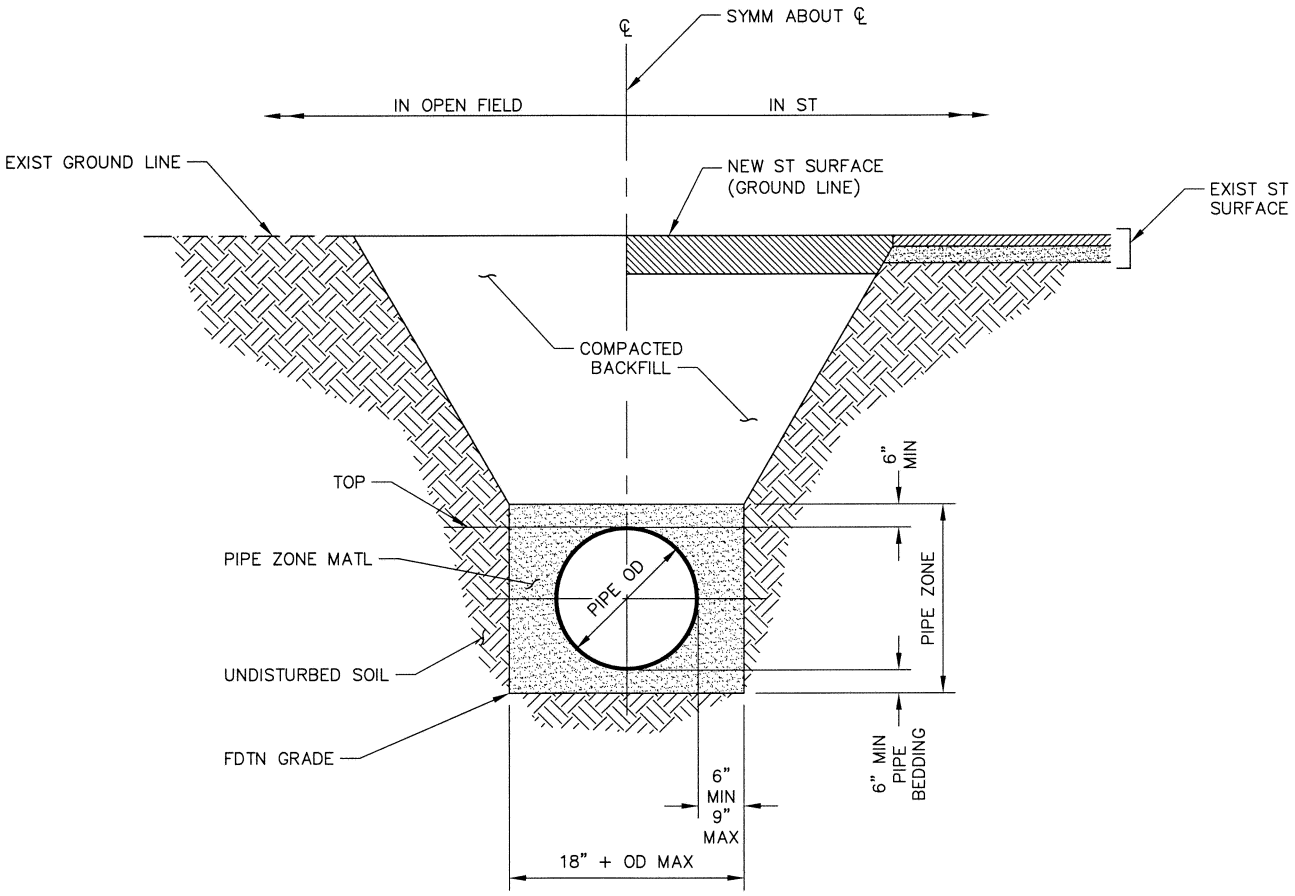

NOTES:

1. MINIMUM COVER SHALL BE 4–FEET 6–INCHES BELOW THE GROUND LINE.
2. TRENCH SHALL CONFORM TO APPLICABLE OSHA REQUIREMENTS.
3. COMPACTION SHALL BE IN ACCORDANCE WITH CHAPTER 7.

DENVER WATER

TYPICAL TRENCH SECTION

Scale: NONE	Date: May 2018
Drawn: RLB	Ck: K ROSS KLR
Approved: Steven C. Rem	Dr. 127 No. 35