


PLAN

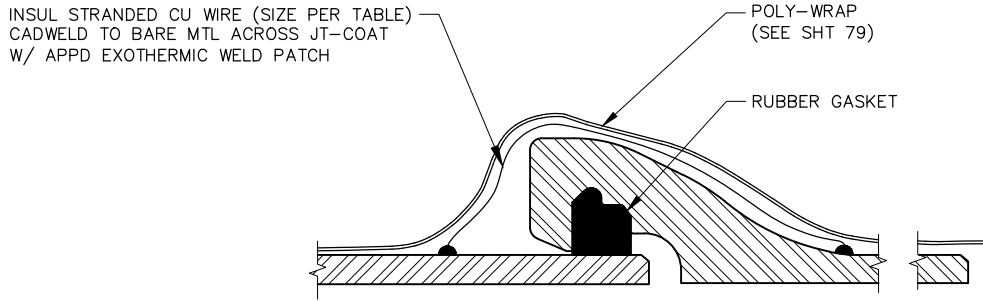


SECTION

NOTES:

1. PROVIDE AND INSTALL REDUNDANT BOND WIRES, EVENLY SPACED AROUND THE PIPE.
2. REMOVE A 2 1/2-INCH SQUARE (MAXIMUM) OF PIPE COATING FOR EXOTHERMIC WELD CONNECTION.
3. WELD CAP SHALL EXTEND AT LEAST 3/4-INCH OVER PIPE COATING.
4. EXOTHERMIC WELDS SHALL BE CLEANED AND COATED.
5. THE SIZING OF AWG INSULATED (HMWPE) SOLID COPPER BOND WIRES:
6. GASKET JOINT TYPE MAY VARY.

NOMINAL PIPE ϕ	WIRE SIZE
4"-12"	#8
16"-20"	#4

ERRATA 2

 DENVER WATER	
METALLIC PIPE JOINT BONDING	
Scale: <u> NONE </u>	Date: <u> January 2020 </u>
Drawn: <u> RLB </u>	Ck: <u> K ROSS </u>
Approved: <u> <i>[Signature]</i> </u>	Dr. <u> 127 </u> No. <u> 35 </u>